

**Drawing Notes:**


Structural substrates shown in this drawing are for illustrative purposes only.

All DANOPOL membrane hot-air welds should be between 30-40mm. Overlaps should provide sufficient cover to accommodate this requirement.

Gutters should be a minimum of 300mm wide. Localised sumps should be no greater than 500 x 500mm square.

Note A:  
Edge restraint bar should be mechanically fastened at 200mm centres.

Note B:  
Mechanical termination of waterproofing using DANOSA pressure plates, mechanically fastened at 200mm centres.

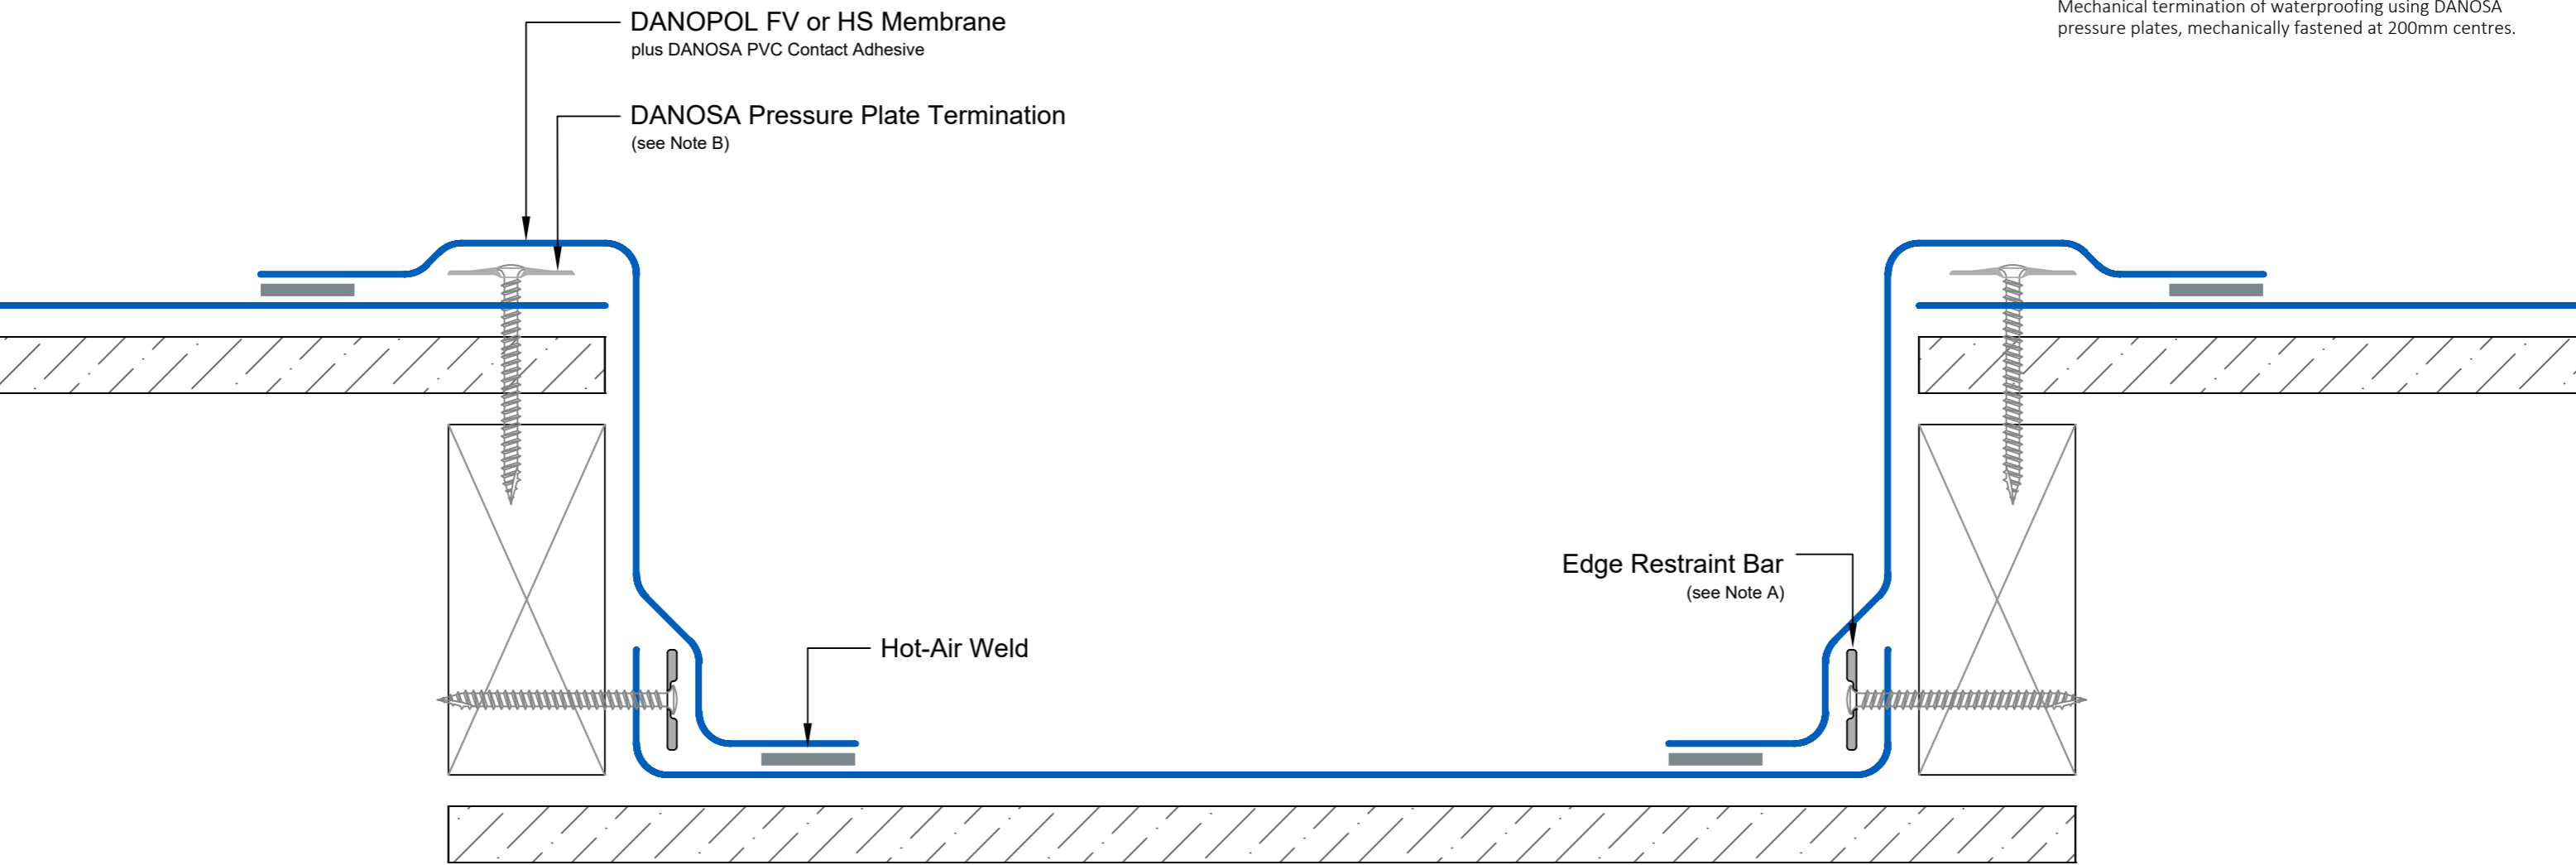

<b>Drawing Number:</b> DUK-S-(A)-231C	<b>Revision:</b> 01
<b>Date Drawn:</b> February 2019	<b>Author:</b> SL

**Drawing Title:**  
Gutter / Sump (Non-Fleecebacked Membranes)  
Adhered DANOPOL® Single Ply Membranes - Cold Roof



**Building together**

**DANOSA UK Limited**

Tel: 0845 074 0553 | www.danosa.co.uk | uktechnical@danosa.com