

**Drawing Notes:**

Structural substrates shown in this drawing are for illustrative purposes only.

All DANOPOL membrane hot-air welds should be between 30-40mm. Overlaps should provide sufficient cover to accommodate this requirement.

Pipes and services which are hot should be insulated to prevent damage to the waterproofing system.


Note A:  
Minimum upstand height is measured from the finished surface of the roof finishes to the first mechanical penetration of the waterproofing or otherwise vulnerable junction. When specifying any finishes, such as paving slabs, stone ballast or a living roof, the measurement is made from the top surface of the finishes, not from the waterproofing level.

Note B:  
Mechanical termination of waterproofing using DANOSA pressure plates, mechanically fastened at 200mm centres.

Note C:  
Sealants are considered maintenance items and should be checked and replaced regularly as part of annual roof maintenance procedures.

Note D:  
Cravat is an optional finish, by others.

Note E:  
DANOSA recommends a bead of DANOSEAL sealant (or similar method) to create an air-seal around the penetration. This recommendation should be followed in conjunction with any internal air-sealing strategy.

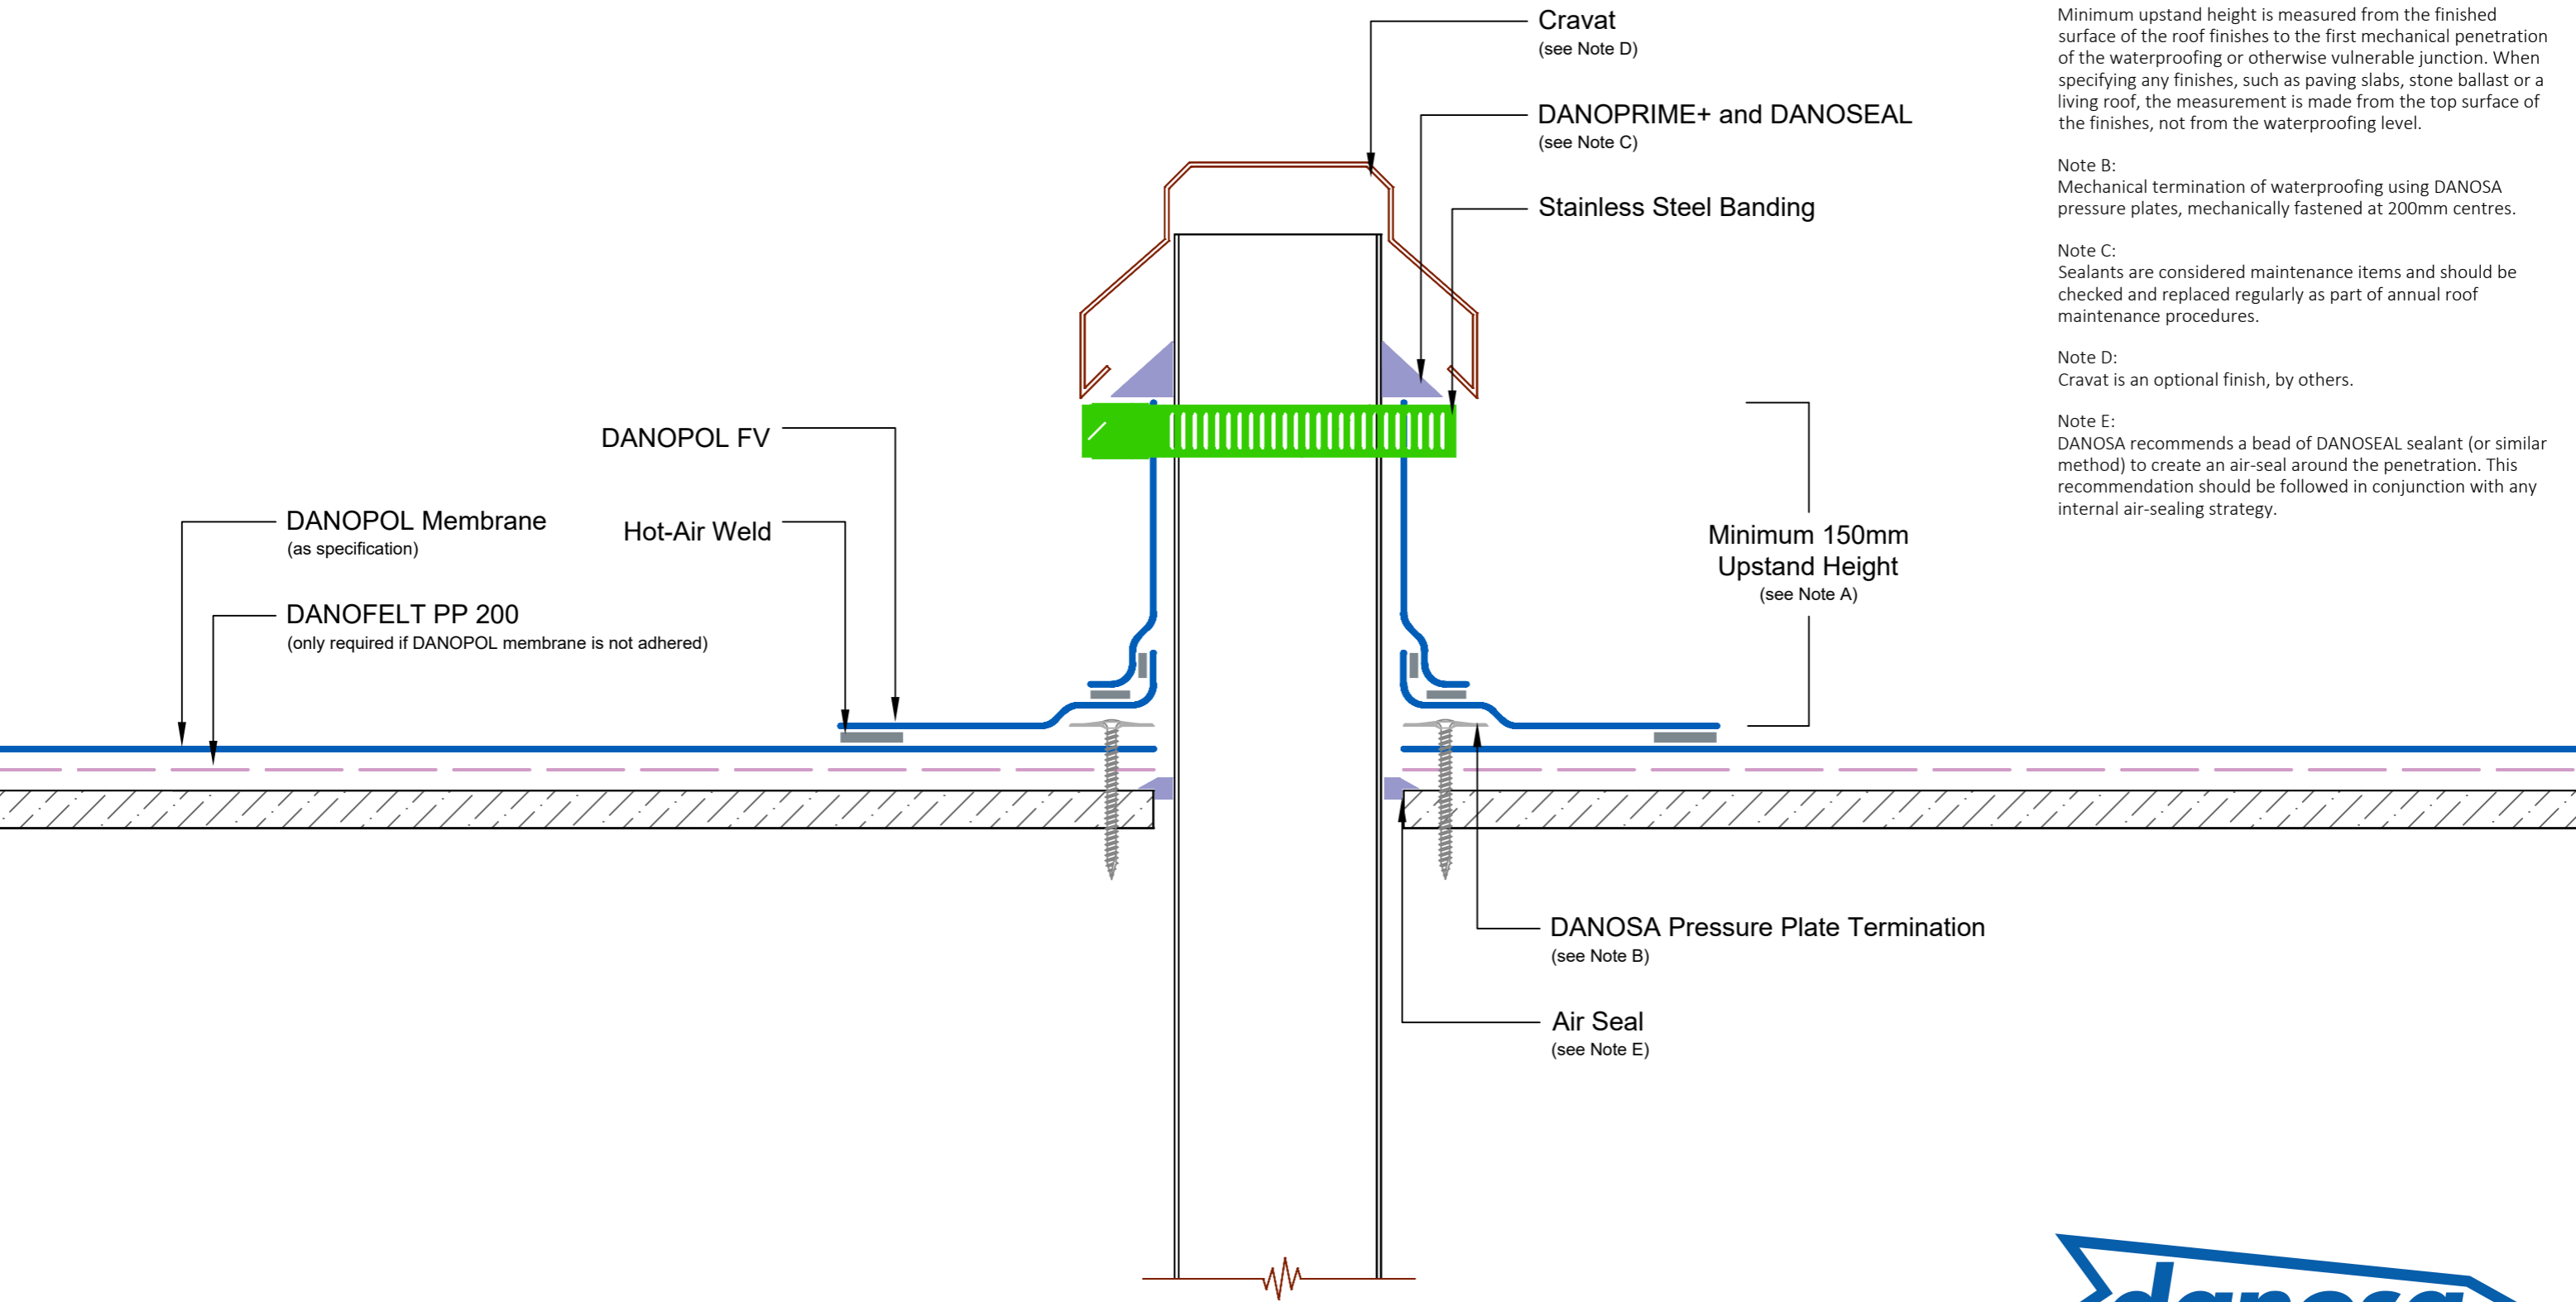

<b>Drawing Number:</b> DUK-S-(G)-290C	<b>Revision:</b> 00
<b>Date Drawn:</b> March 2017	<b>Author:</b> SL

**Drawing Title:**  
Pipe Collar  
DANOPOL® Single Ply Membranes - Cold Roof



**Building together**

**DANOSA UK Limited**

Tel: 0845 074 0553 | www.danosa.co.uk | uktechnical@danosa.com