


Drawing Notes:

All substrates should be primed with BITUMEN PRIMER HM. Structural substrates shown in this drawing are for illustrative purposes only.

Note A:

Stone ballast should be a minimum of 50mm depth. Stones should be round, 20-40mm in diameter and include no sharps.

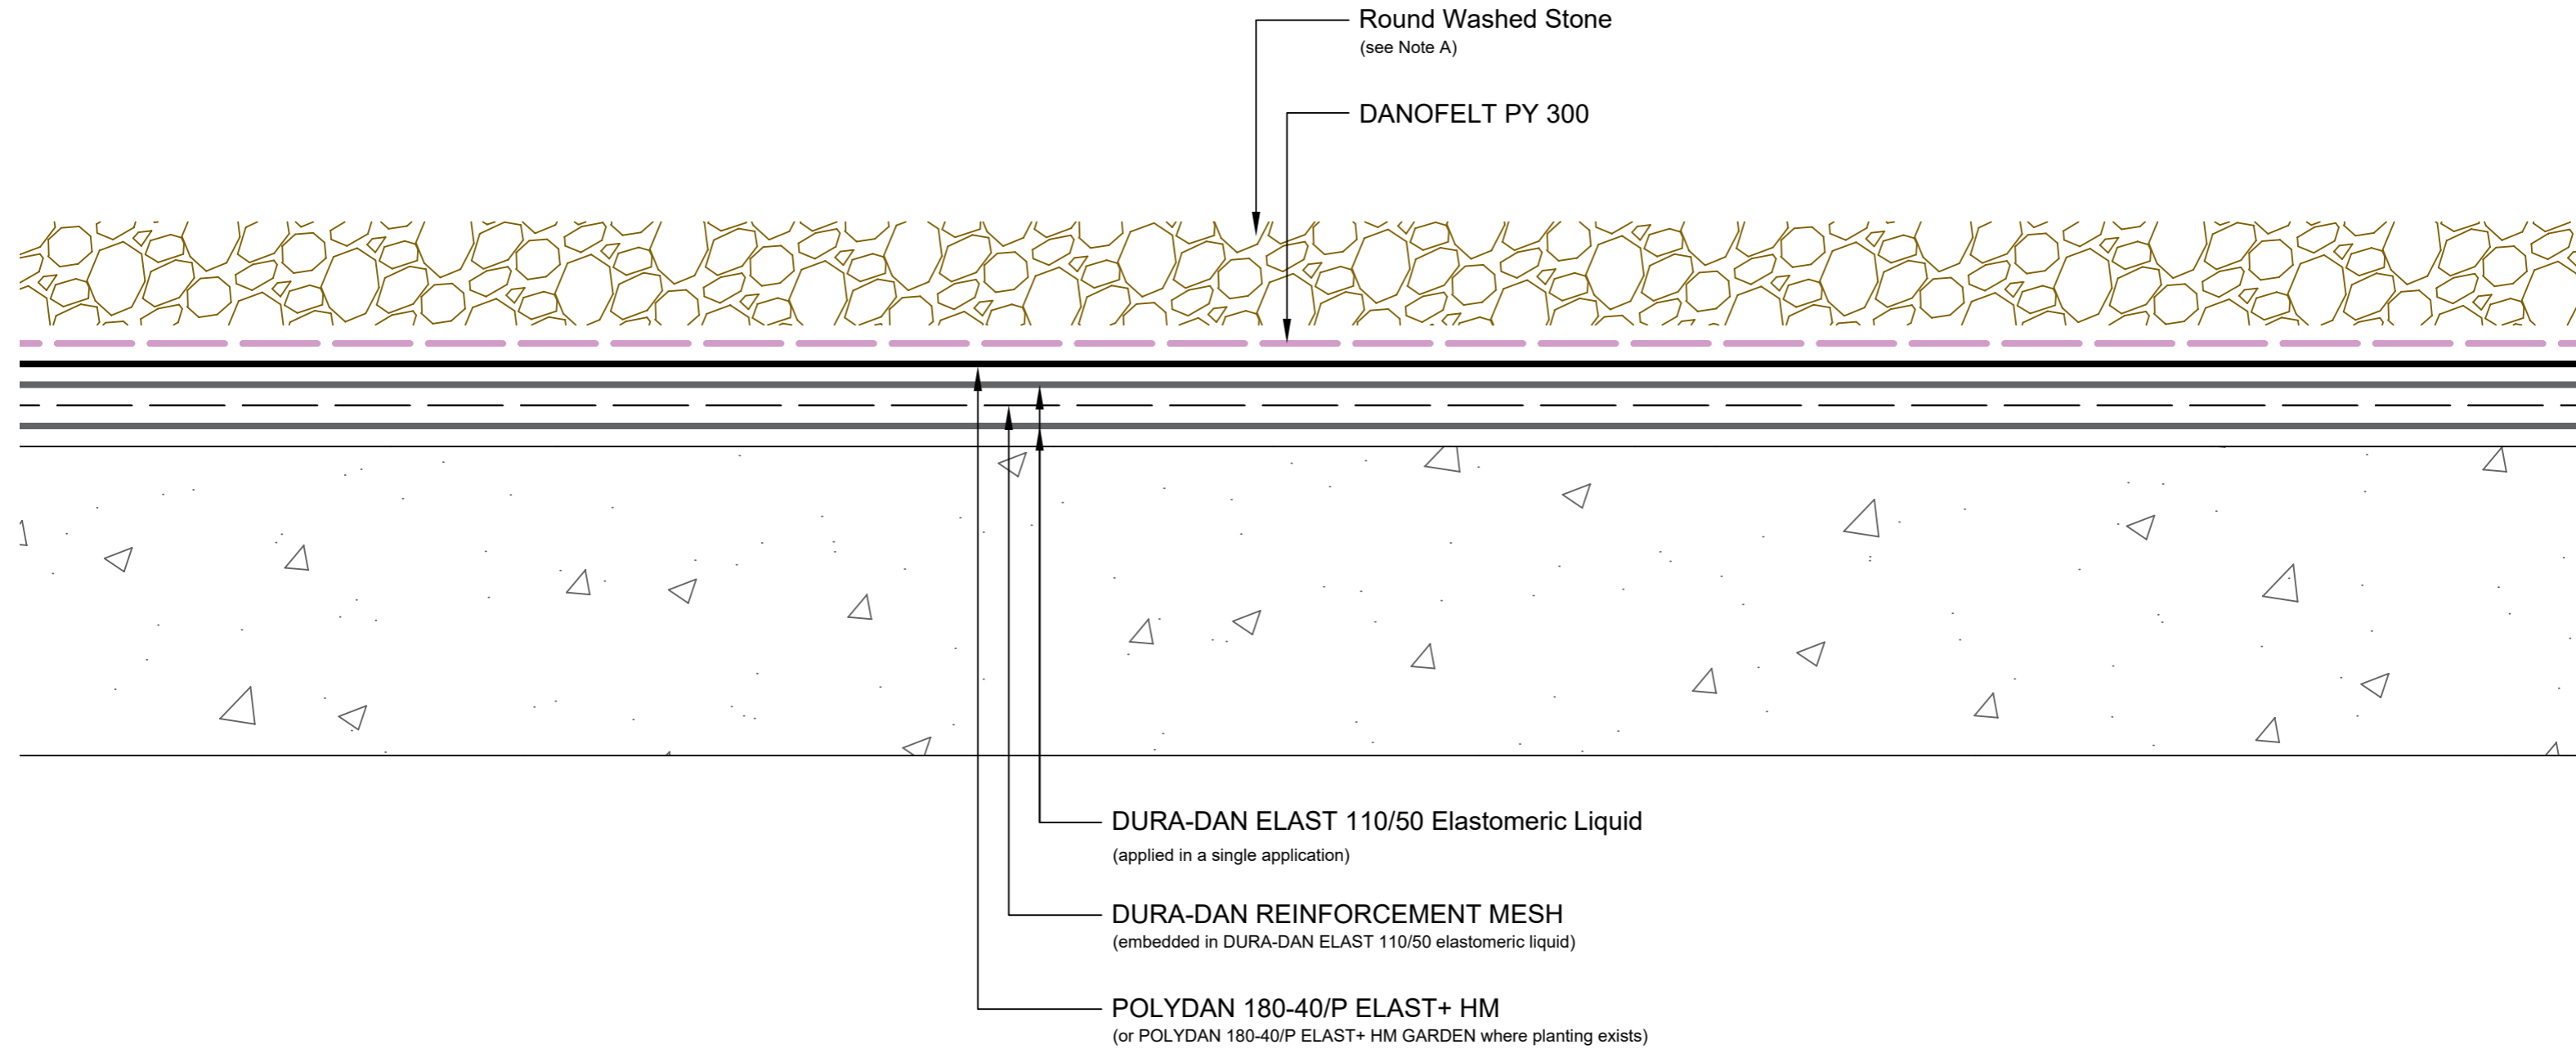

Drawing Number: DUK-D-(G)-201C	Revision: 00
Date Drawn: January 2019	Author: SL

Drawing Title:
Typical Cross Section with Stone Ballast
DURA-DAN® Structural Hot Melt - Cold

