

Drawing Notes:

All substrates should be primed or prepared in accordance with the project specification. Structural substrates shown in this drawing are for illustrative purposes only.


All reinforced bitumen membrane side overlaps should be a minimum of 80mm and head laps a minimum of 100mm.

All laps and cross joints should be staggered by a minimum of 300mm.

Minimum 300mm Head Lap Stagger
(subsequent layers also offset by a minimum 300mm)



Minimum 300mm Cross Joint Stagger
(subsequent layers also offset by a minimum 300mm)

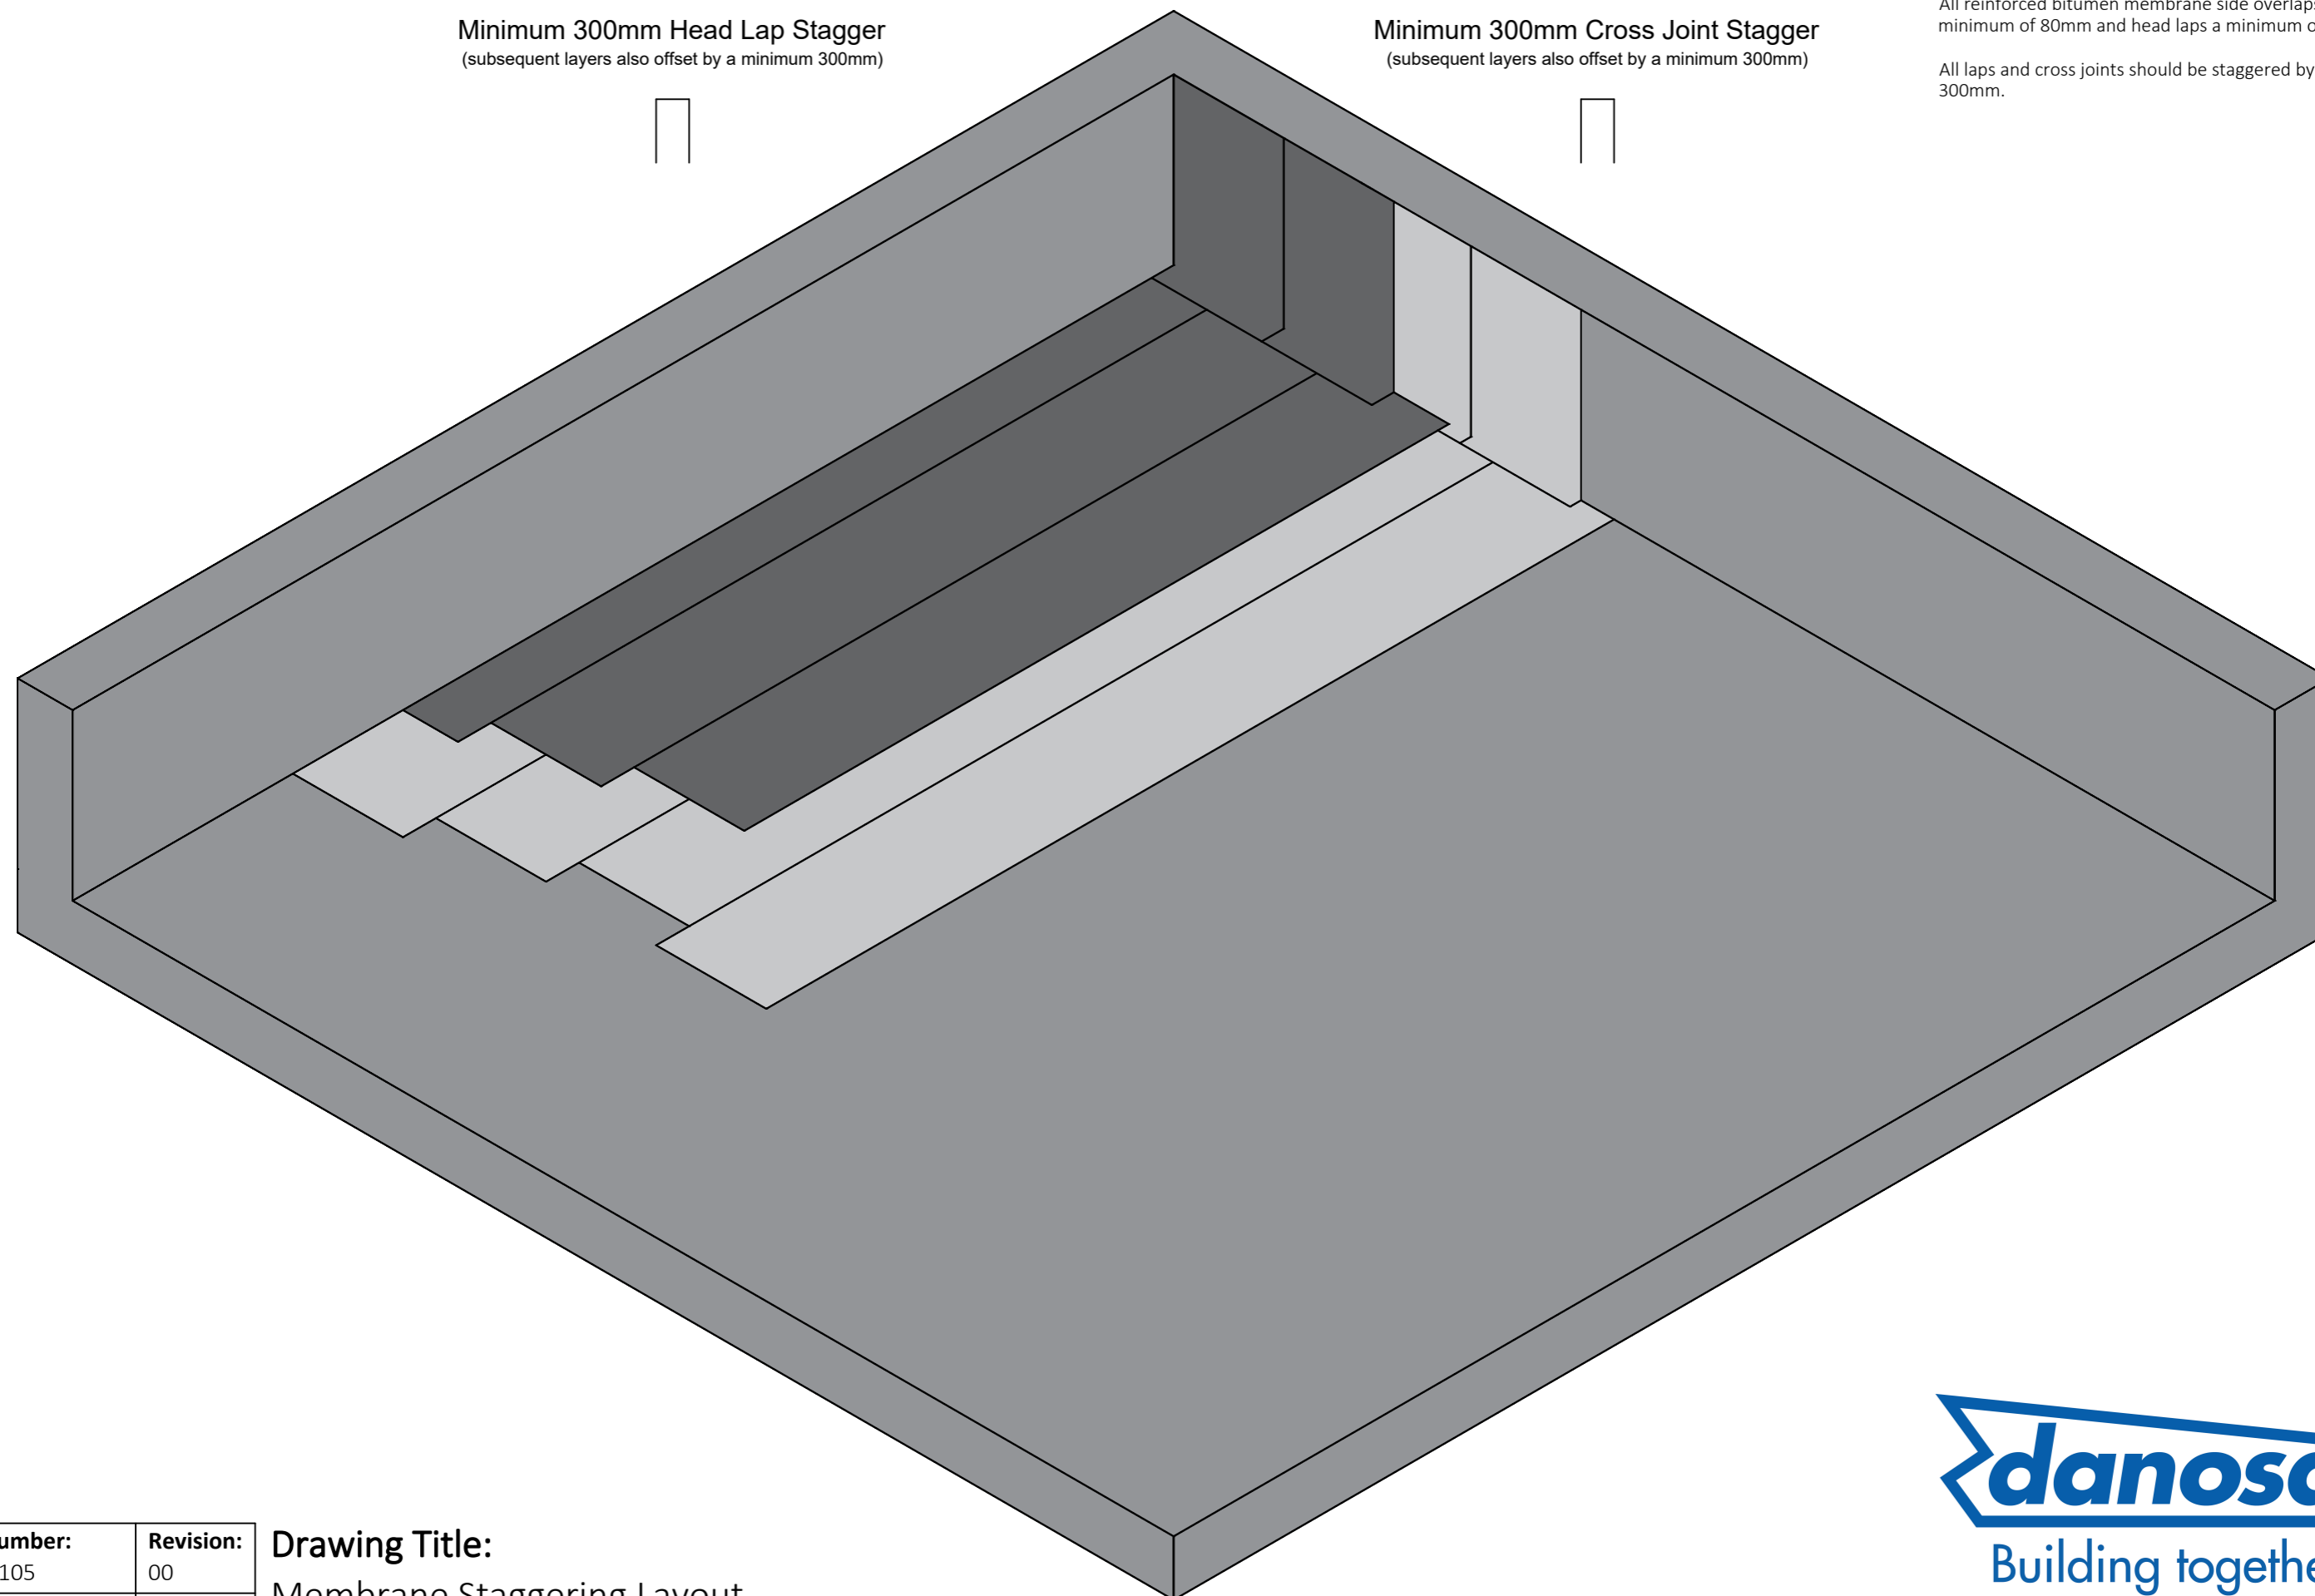

Drawing Number: DUK-B-(G)-105	Revision: 00
Date Drawn: February 2019	Author: SL

Drawing Title:
Membrane Staggering Layout
Reinforced Bitumen Membranes

