

Drawing Notes:

All substrates should be primed or prepared in accordance with the project specification. Structural substrates shown in this drawing are for illustrative purposes only.


All reinforced bitumen membrane side overlaps should be a minimum of 80mm and head laps a minimum of 100mm.

Note A:

Where a full bond to the substrate is required, or where ESTERDAN 30 P ELAST SEMIADHESVIO is used as the underlay, GLASDAN 800 PERFORADO does not form part of the system.

Note B:

Drip card former to be mechanically fastened at 200mm centres. Alternatively, 2 staggered lines of roofing grade clout nails secured at 150mm centres on each staggered line.

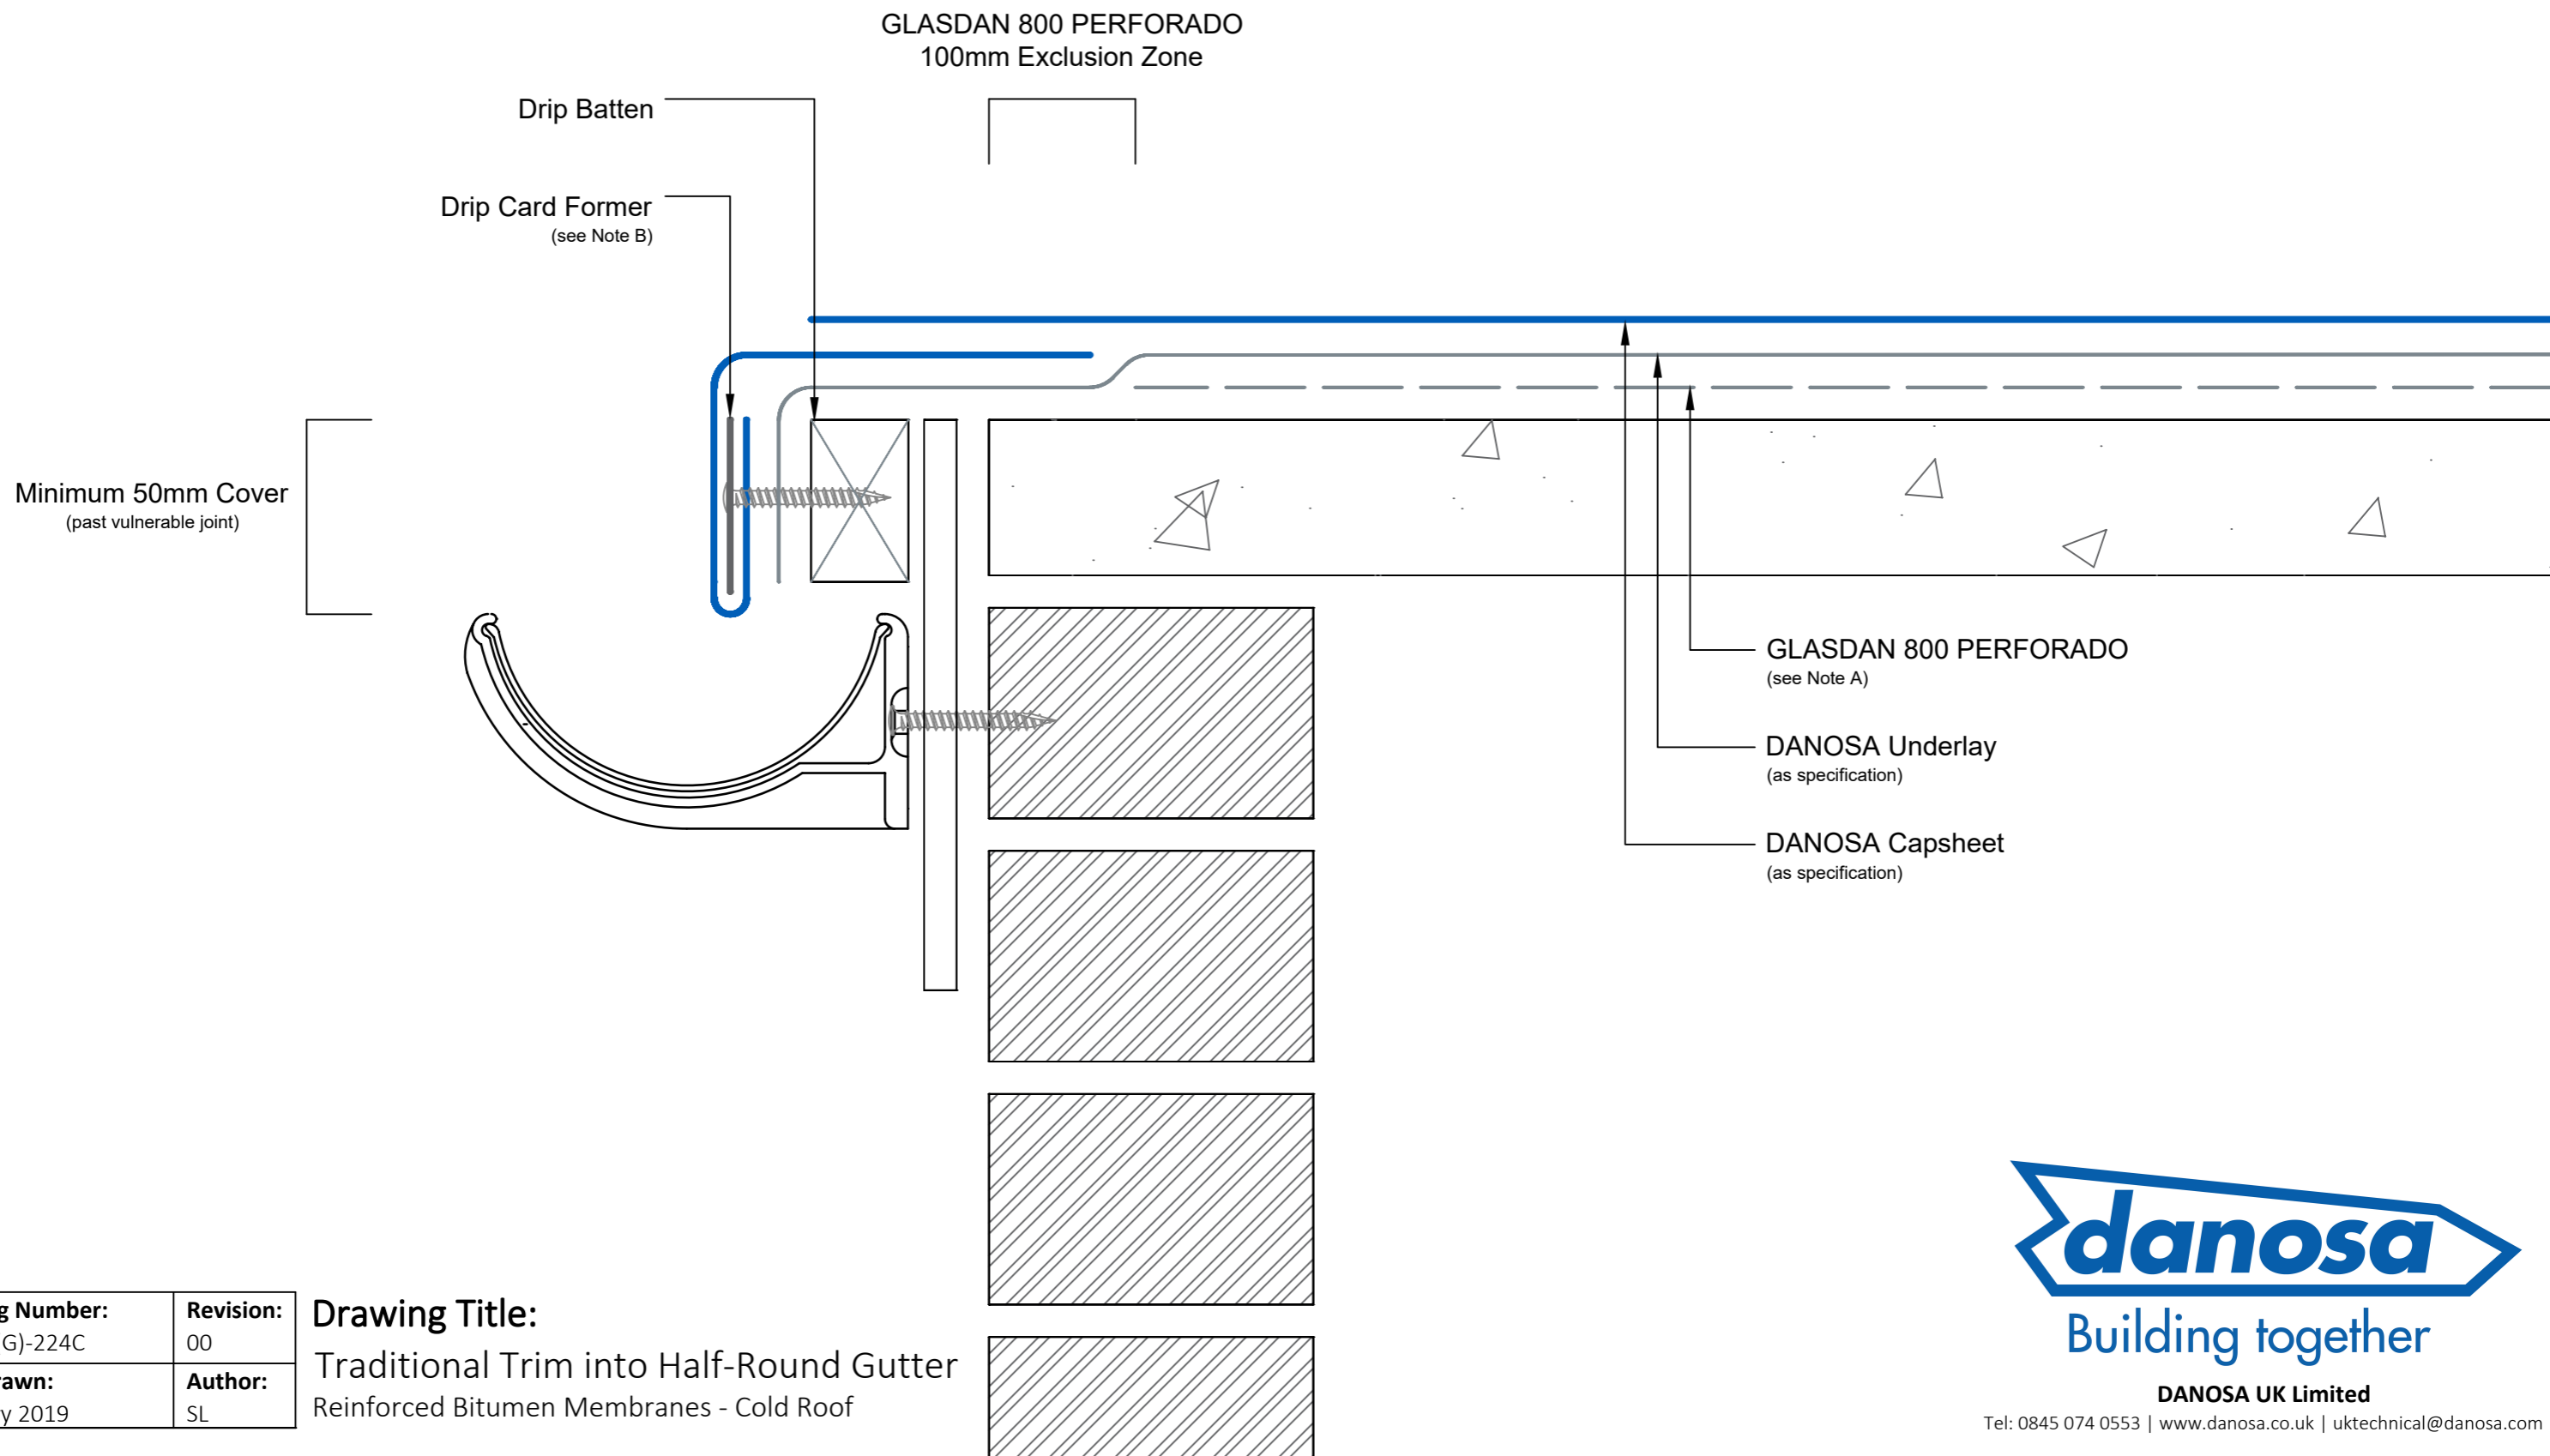

Drawing Number: DUK-B-(G)-224C	Revision: 00
Date Drawn: February 2019	Author: SL

Drawing Title:
Traditional Trim into Half-Round Gutter
Reinforced Bitumen Membranes - Cold Roof



Building together

DANOSA UK Limited

Tel: 0845 074 0553 | www.danosa.co.uk | uktechnical@danosa.com