

**Drawing Notes:**


All substrates should be primed or prepared in accordance with the project specification. Structural substrates shown in this drawing are for illustrative purposes only.

All reinforced bitumen membrane side overlaps should be a minimum of 80mm and head laps a minimum of 100mm.

Note A:  
Where a full bond to the substrate is required, or where ESTERDAN 30 P ELAST SEMIADHESVIO is used as the underlay, GLASDAN 800 PERFORADO does not form part of the system.

Note B:  
Drip card former to be mechanically fastened at 200mm centres. Alternatively, 2 staggered lines of roofing grade clout nails secured at 150mm centres on each staggered line.

Note C:  
Fascia plate shown for illustrative purposes only. Vulnerable joint must be protected from wind-driven elements.

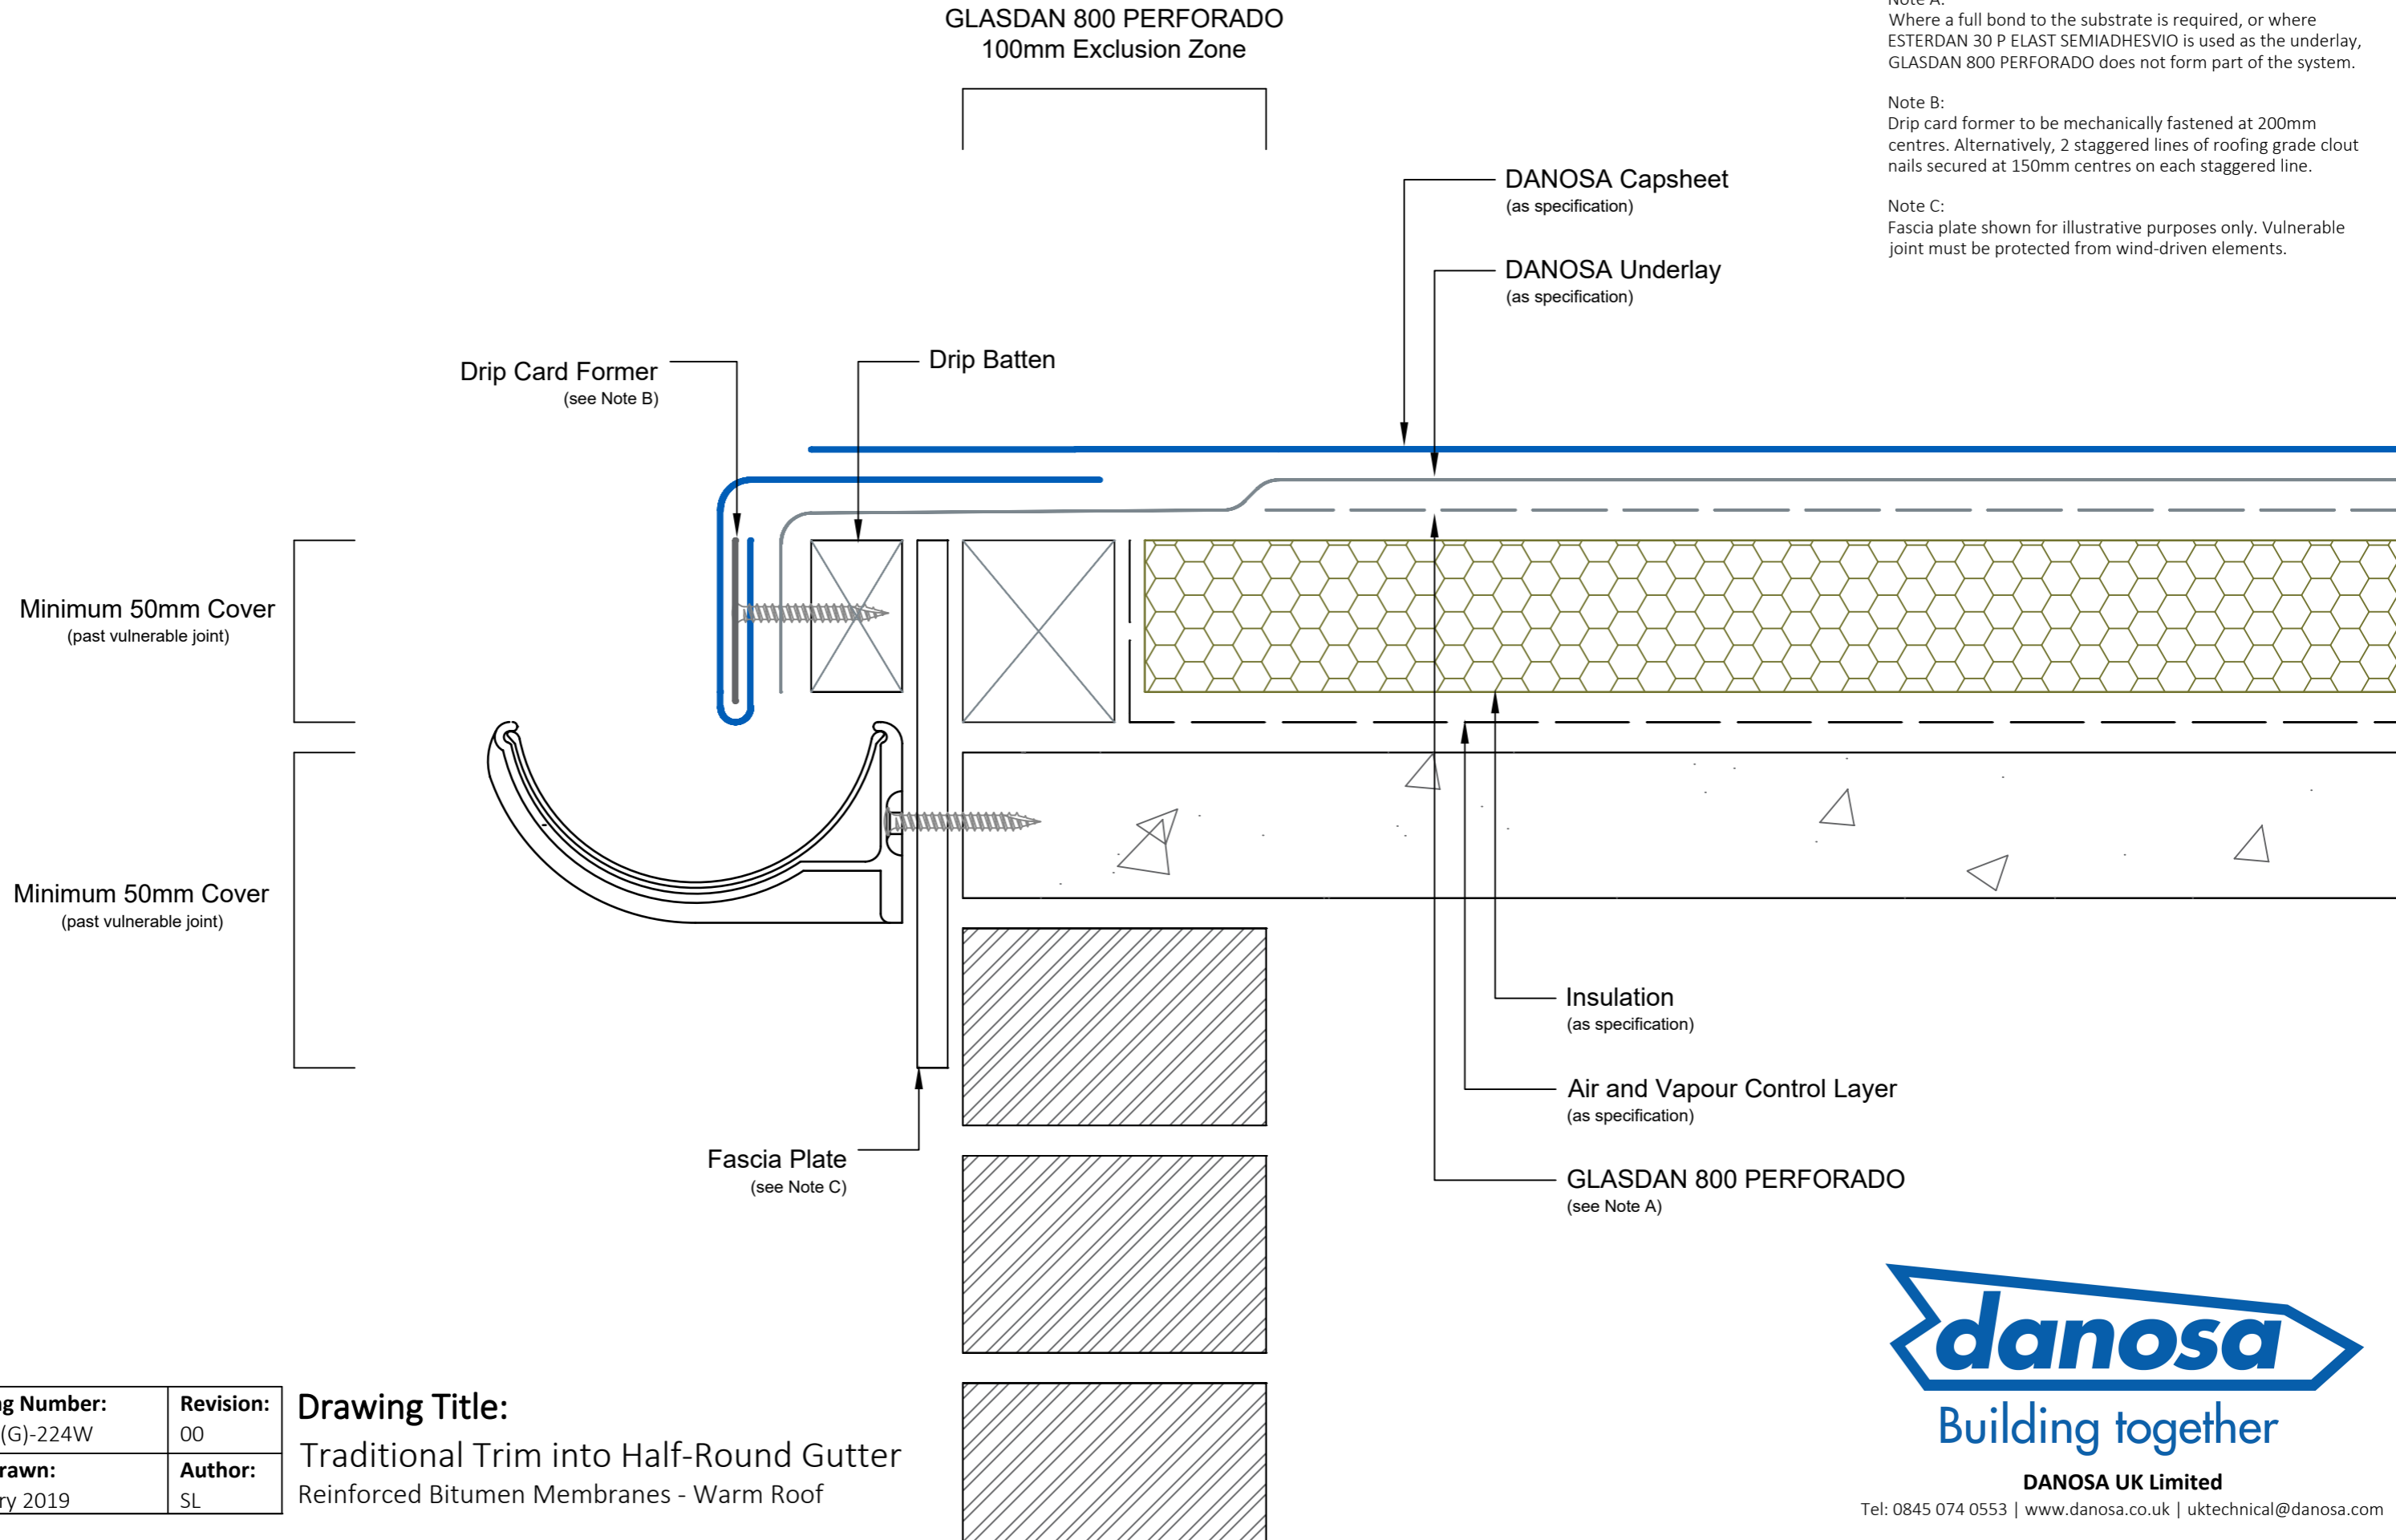

<b>Drawing Number:</b> DUK-B-(G)-224W	<b>Revision:</b> 00
<b>Date Drawn:</b> February 2019	<b>Author:</b> SL

**Drawing Title:**  
Traditional Trim into Half-Round Gutter  
Reinforced Bitumen Membranes - Warm Roof