

**Drawing Notes:**

All substrates should be primed or prepared in accordance with the project specification. Structural substrates shown in this drawing are for illustrative purposes only.


All reinforced bitumen membrane side overlaps should be a minimum of 80mm and head laps a minimum of 100mm.

**Note A:**  
Where a full bond to the substrate is required, or where ESTERDAN 30 P ELAST SEMIADHESVIO is used as the underlay, GLASDAN 800 PERFORADO does not form part of the system.

**Note B:**  
Trim to be mechanically fastened at 200mm centres. Various profiles, colours and finishes are available. Profile shown for illustrative purposes only.

**Note C:**  
Minimum upstand height is measured from the finished surface of the roof finishes to the first mechanical penetration of the waterproofing or otherwise vulnerable junction. When specifying any finishes, such as paving slabs, stone ballast or a living roof, the measurement is made from the top surface of the finishes, not from the waterproofing level.

**Note D:**  
DANOSA Edge Restraint Bar (or similar), mechanically fastened at 200mm centres.

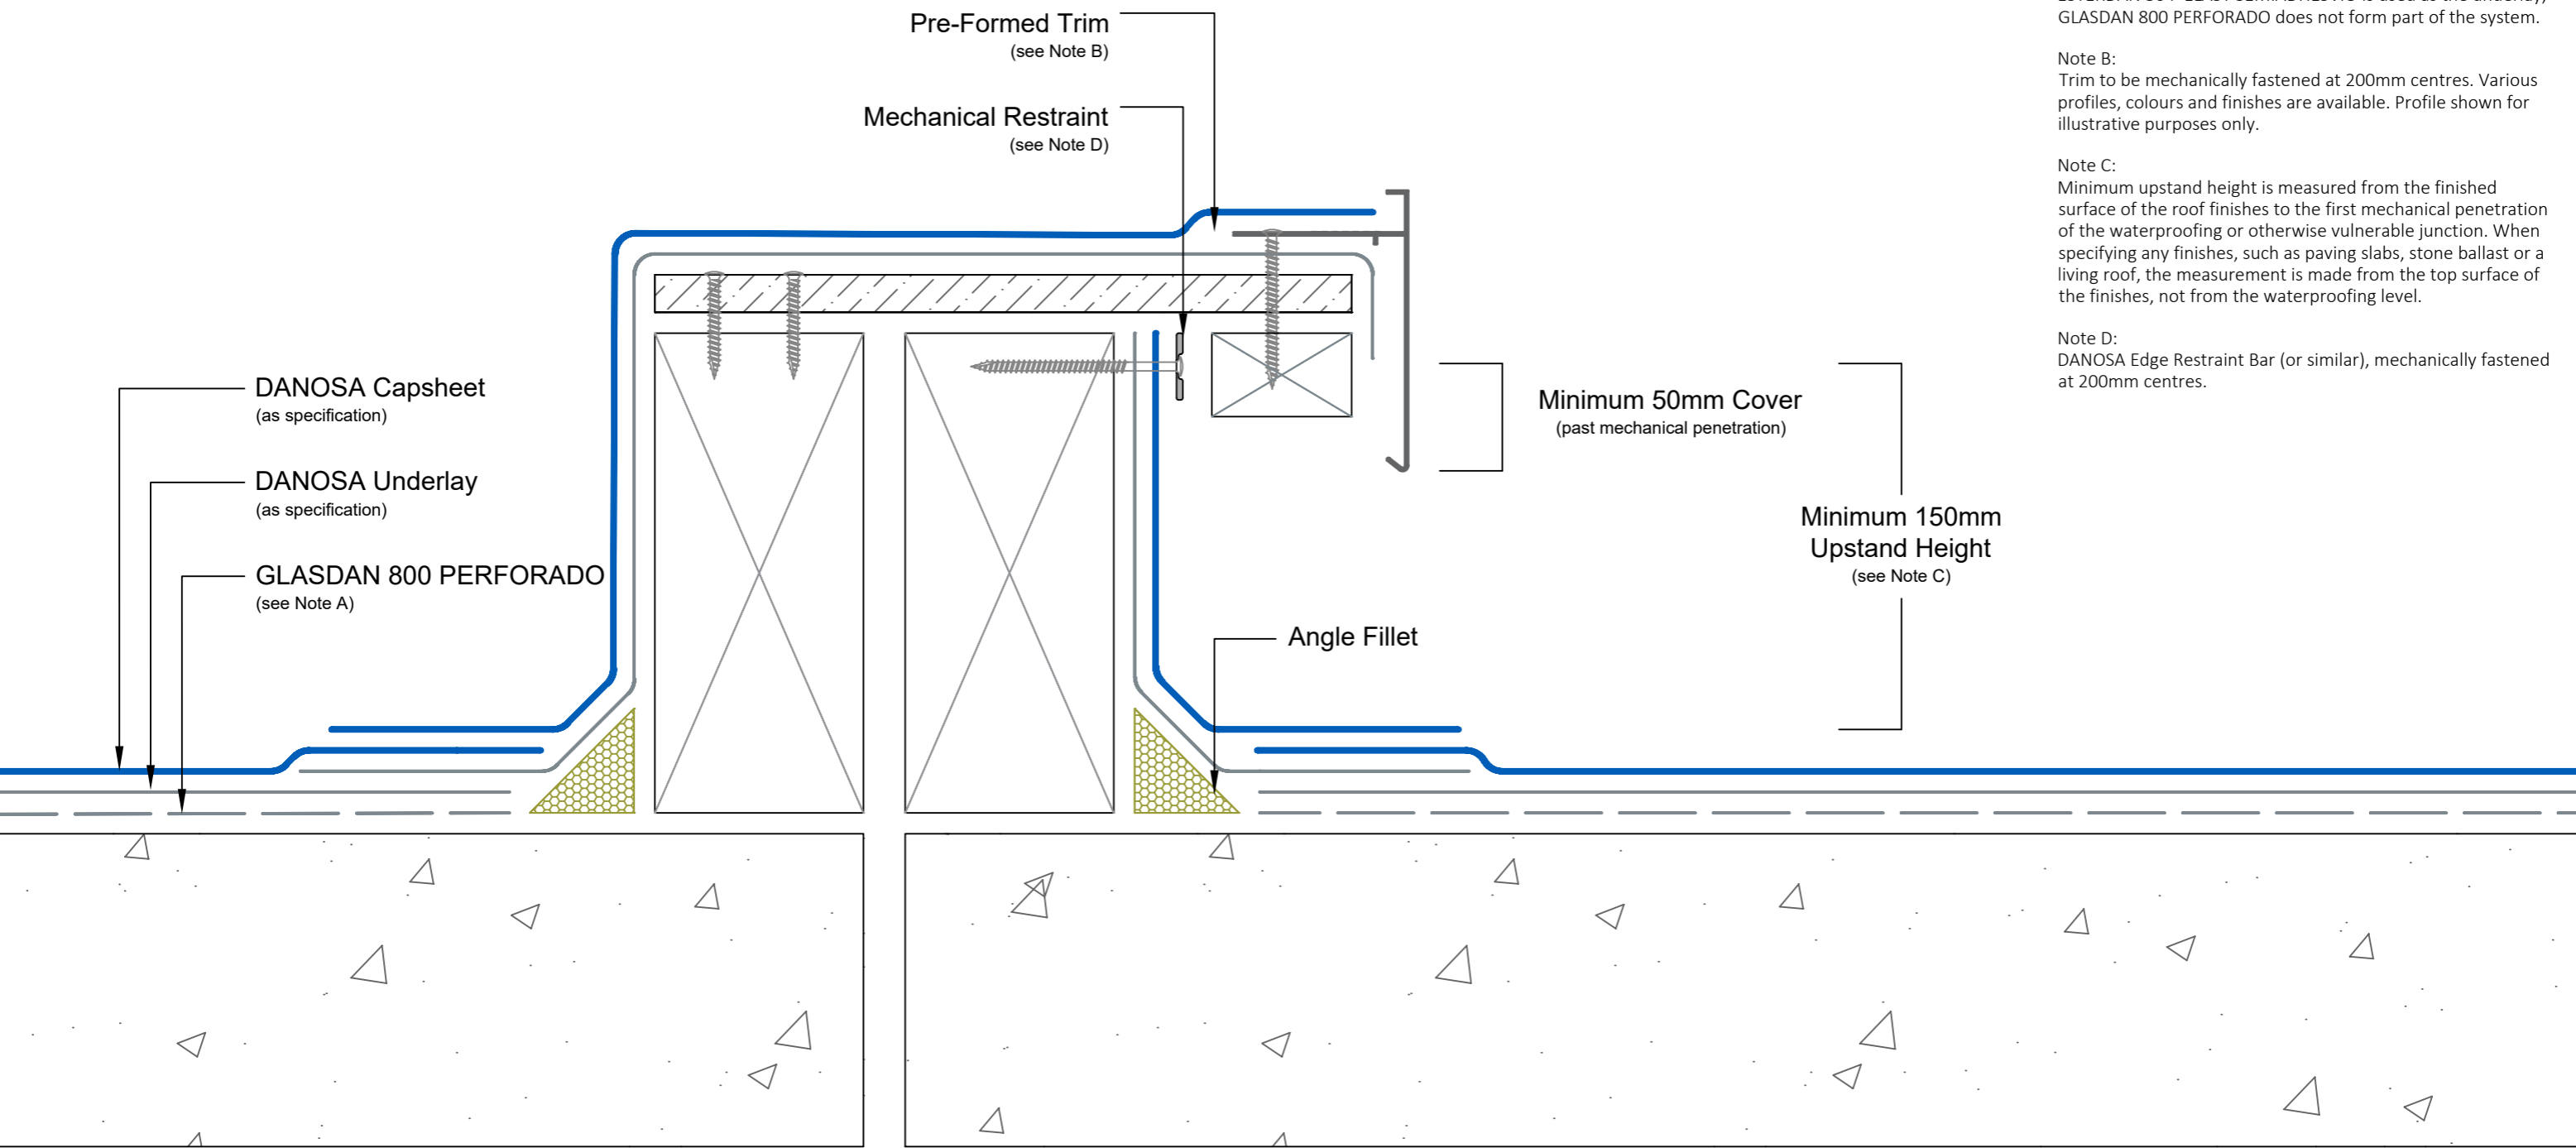

<b>Drawing Number:</b> DUK-B-(G)-280C	<b>Revision:</b> 01
<b>Date Drawn:</b> February 2019	<b>Author:</b> SL

**Drawing Title:**  
Expansion Kerb  
Reinforced Bitumen Membranes - Cold Roof



**Building together**

**DANOSA UK Limited**

Tel: 0845 074 0553 | www.danosa.co.uk | uktechnical@danosa.com