


Disclaimer: Drawings produced by DANOSA UK should be considered non-scalable and for illustrative purposes only. Issued design principals form instructions for the installation of DANOSA UK materials only and should be considered as part of an overall design rather than in isolation. Product 'Technical Datasheets' are available for all DANOSA UK products and should be consulted in conjunction with all issued DANOSA UK installation instructions. Drawings are subject to copyright and should not be reproduced without permission.

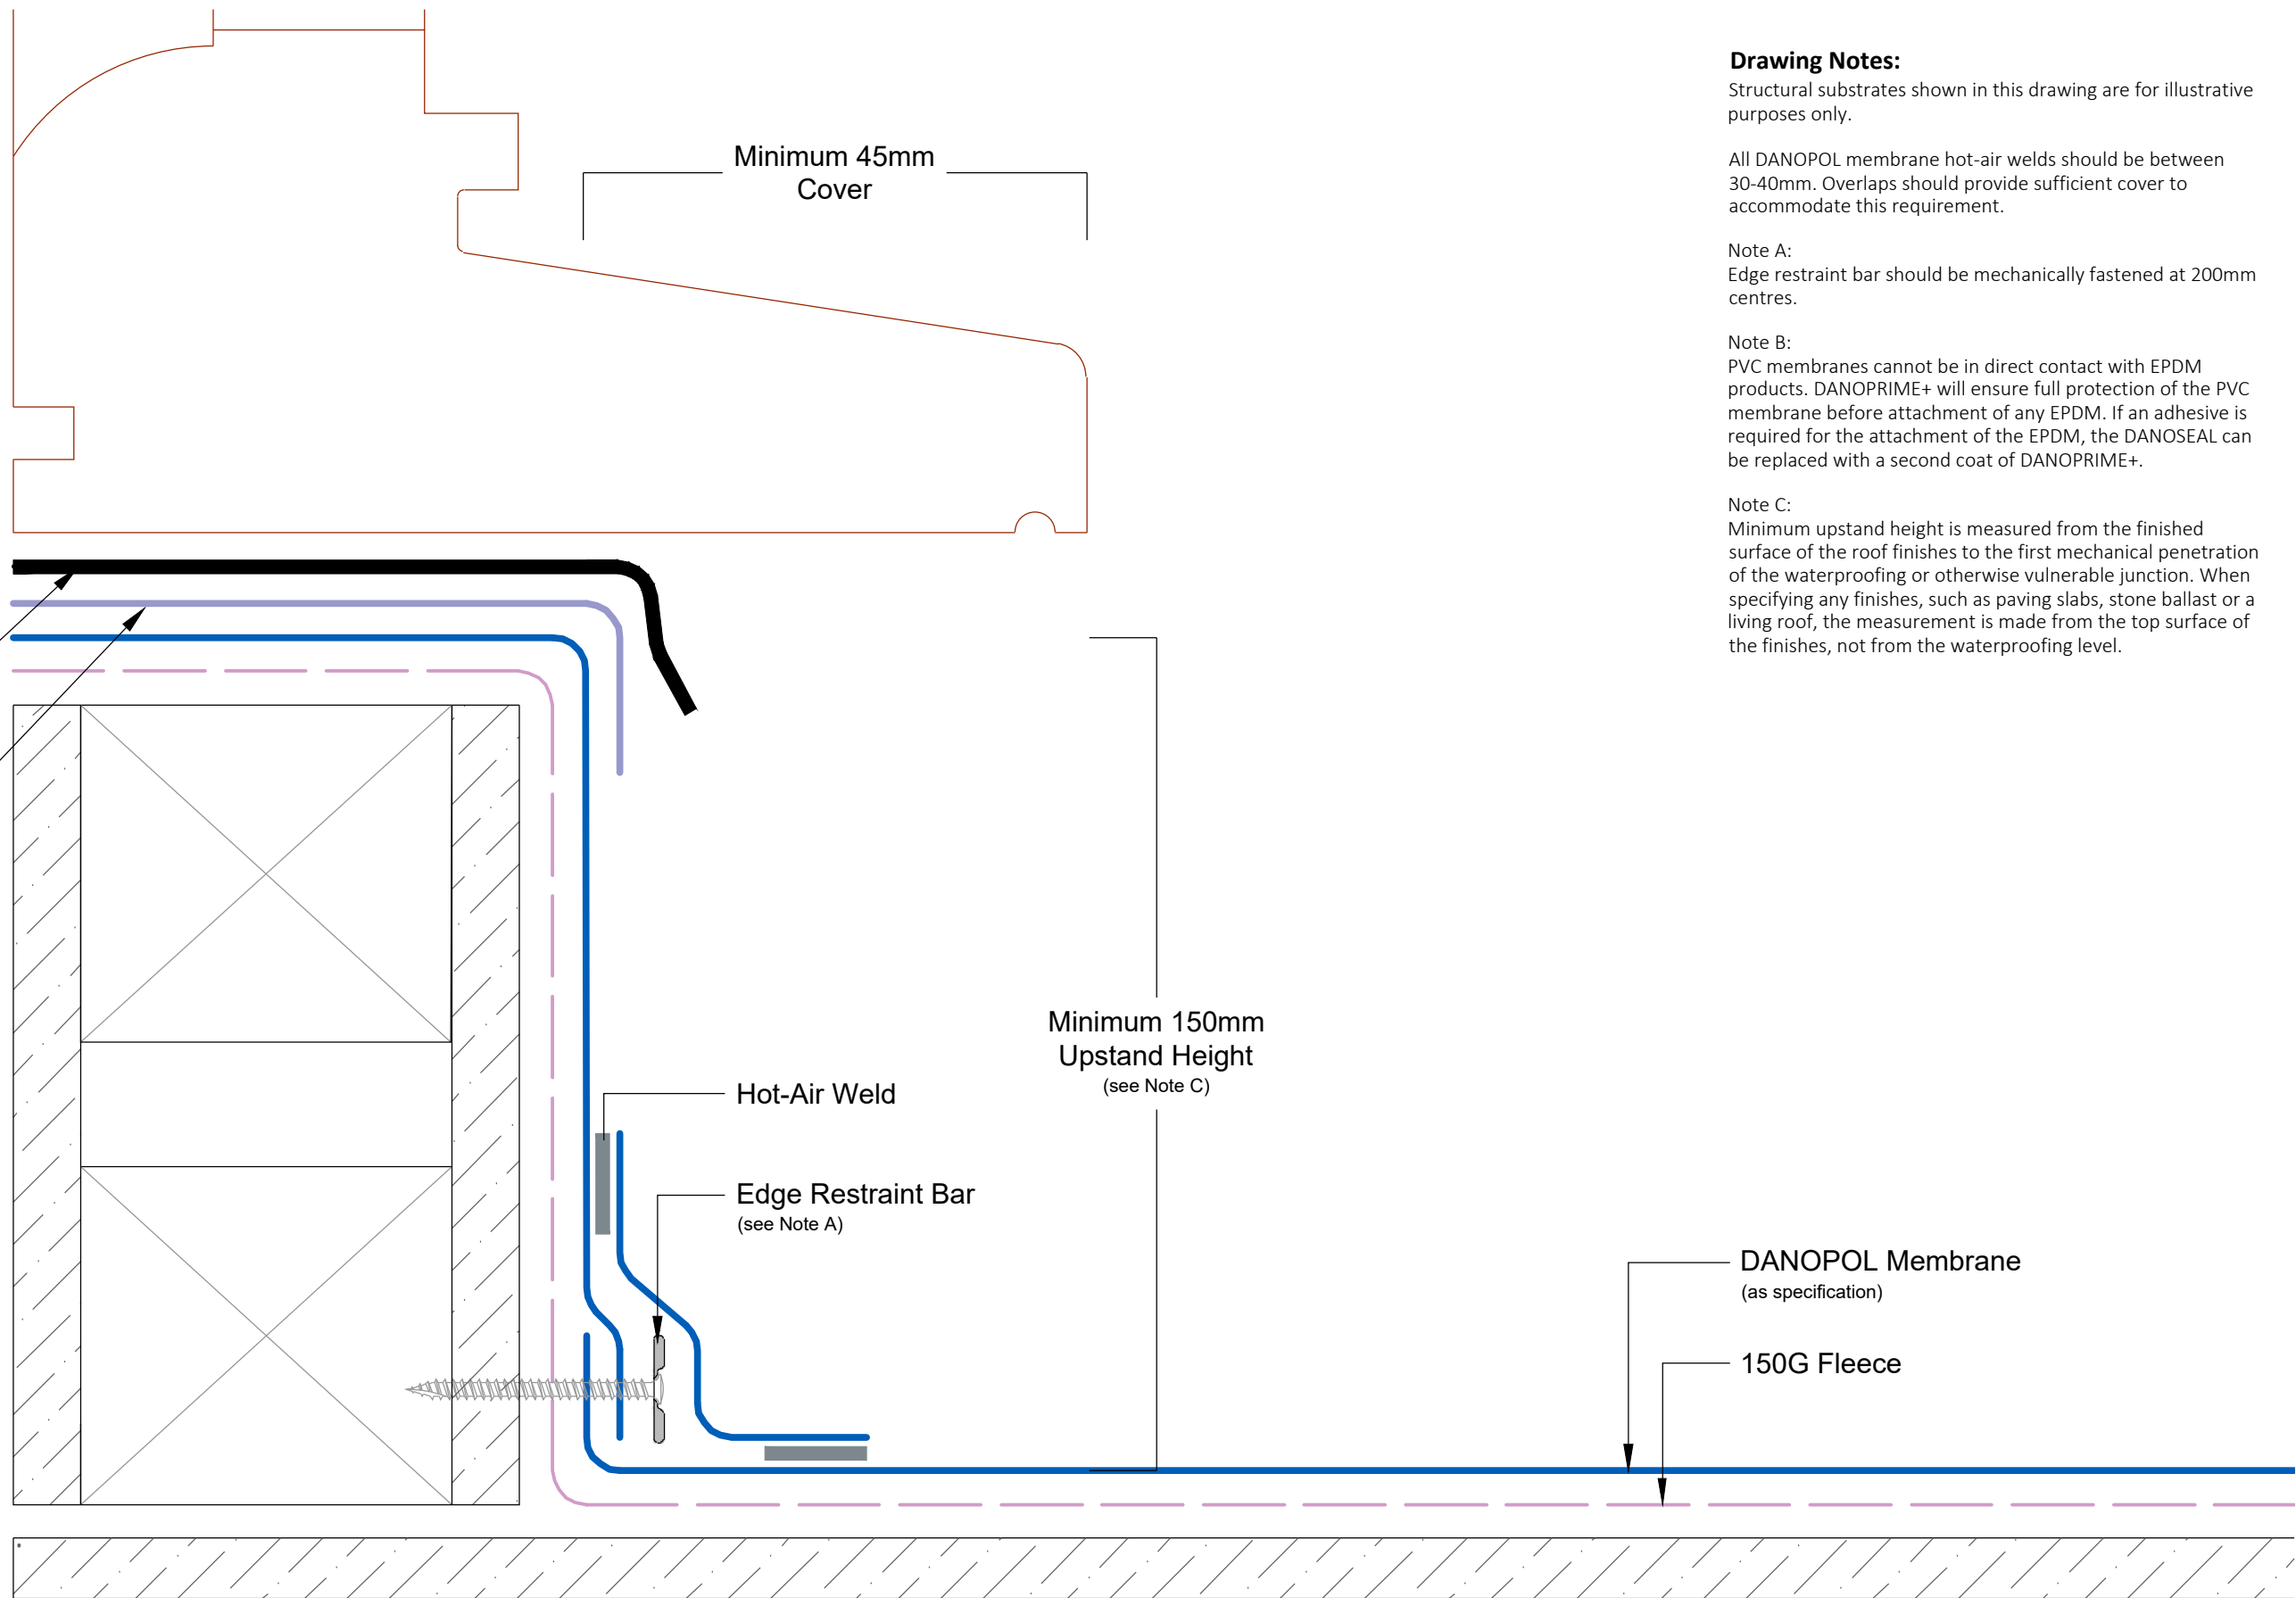

Drawing Notes:
Structural substrates shown in this drawing are for illustrative purposes only.

All DANOPOL membrane hot-air welds should be between 30-40mm. Overlaps should provide sufficient cover to accommodate this requirement.

Note A:
Edge restraint bar should be mechanically fastened at 200mm centres.

Note B:
PVC membranes cannot be in direct contact with EPDM products. DANOPRIME+ will ensure full protection of the PVC membrane before attachment of any EPDM. If an adhesive is required for the attachment of the EPDM, the DANOSEAL can be replaced with a second coat of DANOPRIME+.

Note C:
Minimum upstand height is measured from the finished surface of the roof finishes to the first mechanical penetration of the waterproofing or otherwise vulnerable junction. When specifying any finishes, such as paving slabs, stone ballast or a living roof, the measurement is made from the top surface of the finishes, not from the waterproofing level.

EPDM Flashing
(or similar suitable
compression sea - optional)

DANOPRIME+ and
DANOSEAL Sealant
(see Note B)

Minimum 150mm
Upstand Height
(see Note C)

Hot-Air Weld

Edge Restraint Bar
(see Note A)

DANOPOL Membrane
(as specification)

150G Fleece

Drawing Number: DUK-S-(M)-260C	Revision: 00
Date Drawn: March 2017	Author: SL

Drawing Title:
Junction with Window, Door or Aperture Cill
Mechanically Fastened Single Ply Membranes - Cold Roof

